

INSTALL 6" CONCRETE MONOLITHIC CURB WHEN GRADE DIFFERENCE EXCEEDS 4 INCHES. TOP OF CURB SHALL BE LEVEL WITH ENDS MATCHING SIDEWALK GRADE.

REMOVE & REPLACE SIDEWALK IN EITHER DIRECTION TO MAINTAIN A MAX. SLOPE OF 1:12

MATCH WIDTH OF SIDEWALK (BUT NOT LESS THAN 4', 5' MIN. NEW CONSTRUCTION)

INSTALL 6" CONCRETE MONOLITHIC CURB WHERE WING CAN NOT BE CONSTRUCTED. TOP OF CURB SHALL BE STRAIGHT GRADE FROM TOP OF RAMP TO TOP OF CURB.

DETECTABLE WARNING & WELL

MONOLITHIC CURB IF REQUIRED FOR CLEARANCE TOP OF CURB LEVEL TO MATCH SIDEWALK GRADE

MIN. 1' WIDE 2.5" THICK ASPHALT PATCH



REPLACE CURB & GUTTER

SAWCUT CURB & GUTTER (EACH SIDE)

4'x4' MIN. LEVEL LANDING
5'x5' NEW CONSTRUCTION

FLOW-LINE (NO JOINT, 1/4" LIP)

SLOPE CURB

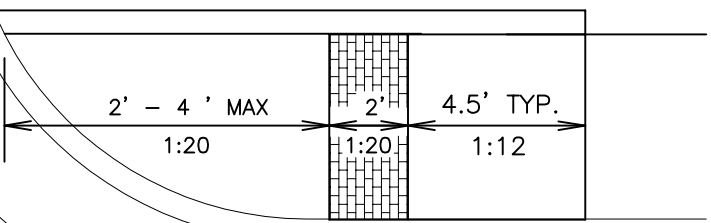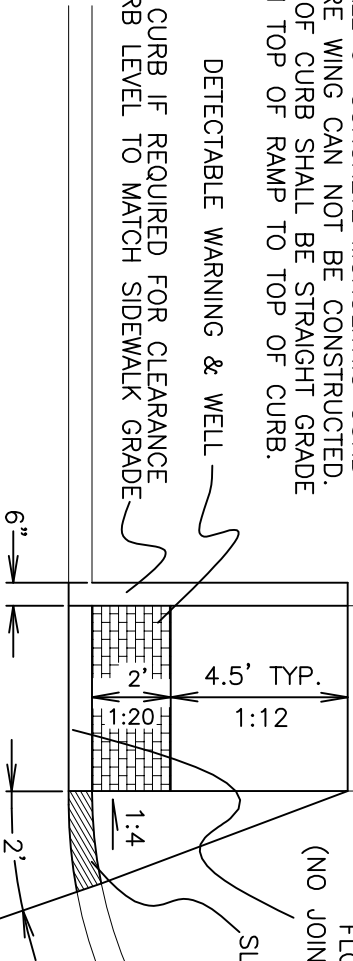

ALTERNATE RAMP "C"

TYP. SIDEWALK RAMP "C"

S-6C



CITY OF CANON CITY
ENGINEERING DEPARTMENT
STANDARD DETAIL
REVISED: AUGUST 2008
S-6C