

REFERENCE NOTES SCHEDULE

| SYMBOL | CODE | DESCRIPTION | QTY |
|-------------|------|--|-----------|
| 1 LANDSCAPE | I-01 | PLANTING AREAS. STONE MULCH. SEE SPECIFICATIONS. | 25,650 cy |

PLANT SCHEDULE

| SYMBOL | QTY | BOTANICAL NAME | COMMON NAME | CONT | CAL |
|------------------------|-----|------------------------------------|----------------------------|-------|----------|
| DECIDUOUS TREES | | | | | |
| | 4 | Acer ginnala | Amur Maple | B & B | 1.5' Cal |
| | 5 | Koelreuteria paniculata | Golden Rain Tree | B & B | 1.5' Cal |
| | 8 | Ulmus parvifolia | Lacebark Elm | B & B | 2.5' Cal |
| SHRUBS | | | | | |
| Jb | 7 | Juniperus horizontalis 'Blue Chip' | Blue Chip Juniper | 5 gal | |
| Jx | 49 | Juniperus x 'Grey Owl' | Grey Owl Juniper | 5 gal | |
| Ac | 27 | Ribes alpinum 'Green Mound' | Green Mound Alpine Current | 5 gal | |
| Sp | 28 | Salix purpurea 'Nana' | Dwarf Purple Osier Willow | 5 gal | |
| GRASSES | | | | | |
| c | 48 | Calamagrostis x acutiflora | Feather Reed Grass | 1 gal | |
| h | 24 | Helictotrichon sempervirens | Blue Oat Grass | 1 gal | |

CAÑON CITY LANDSCAPE REQUIREMENTS:

Building foundation landscape zone:
1. Applicable development is required to maintain a building foundation area at front and exterior sides of seven (7) feet at a minimum.

7' Minimum applied to facade facing Field Avenue.

2. Foundation plantings shall be installed across eighty (80) percent of the length of the façade of the building, except where walkways and driveways are located.

Foundation filled 80% across the facade of the building.

3. Foundation plantings may include trees, shrubs, native grasses, and groundcover.

Mix of shrubs and native grasses utilized.

Parking area perimeter landscape zone:

1. One (1) shrub or native grasses the height of which shall not be less than three (3) feet nor greater than five (5) feet, shall be planted for every three (3) feet of landscape area length.

Field Avenue = 166 LF - Shrub/Grass Required = 55.3 (166/3), 57 Provided

Central Avenue = 247 LF - Shrub/Grass Required = 82.3 (247/3), 85 Provided

2. Landscaped areas outside of shrubs/native grasses and tree masses shall be planted in live groundcover. Refer to reference notes for groundcover specifications.

Parking area interior landscape zone:

1. Parking area end cap planting standards: A minimum of one (1) canopy tree and three (3) shrubs or native grasses shall be provided for every parking area end cap. If the end cap extends the width of a double bay, then two (2) canopy trees shall be provided.

Four (4) end caps on site, one (1) the width of a double bay.

5 Canopy trees required - 5 provided.

12 Shrubs (3x4 end caps) required - 12 provided

2. Parking area island planting standards: A minimum of one (1) canopy tree shall be provided for every parking area island. If the island extends the width of a double bay, then two (2) canopy trees shall be provided.


Three (3) parking islands on site.


3 Canopy trees required - 3 provided.

Transition Zone Landscape Requirements:

Site (Retail) resides next to Recreational space and thus is allocated to Type A transition zone.

Minimum of four (4) Canopy/Evergreen trees required, 4 Trees provided.



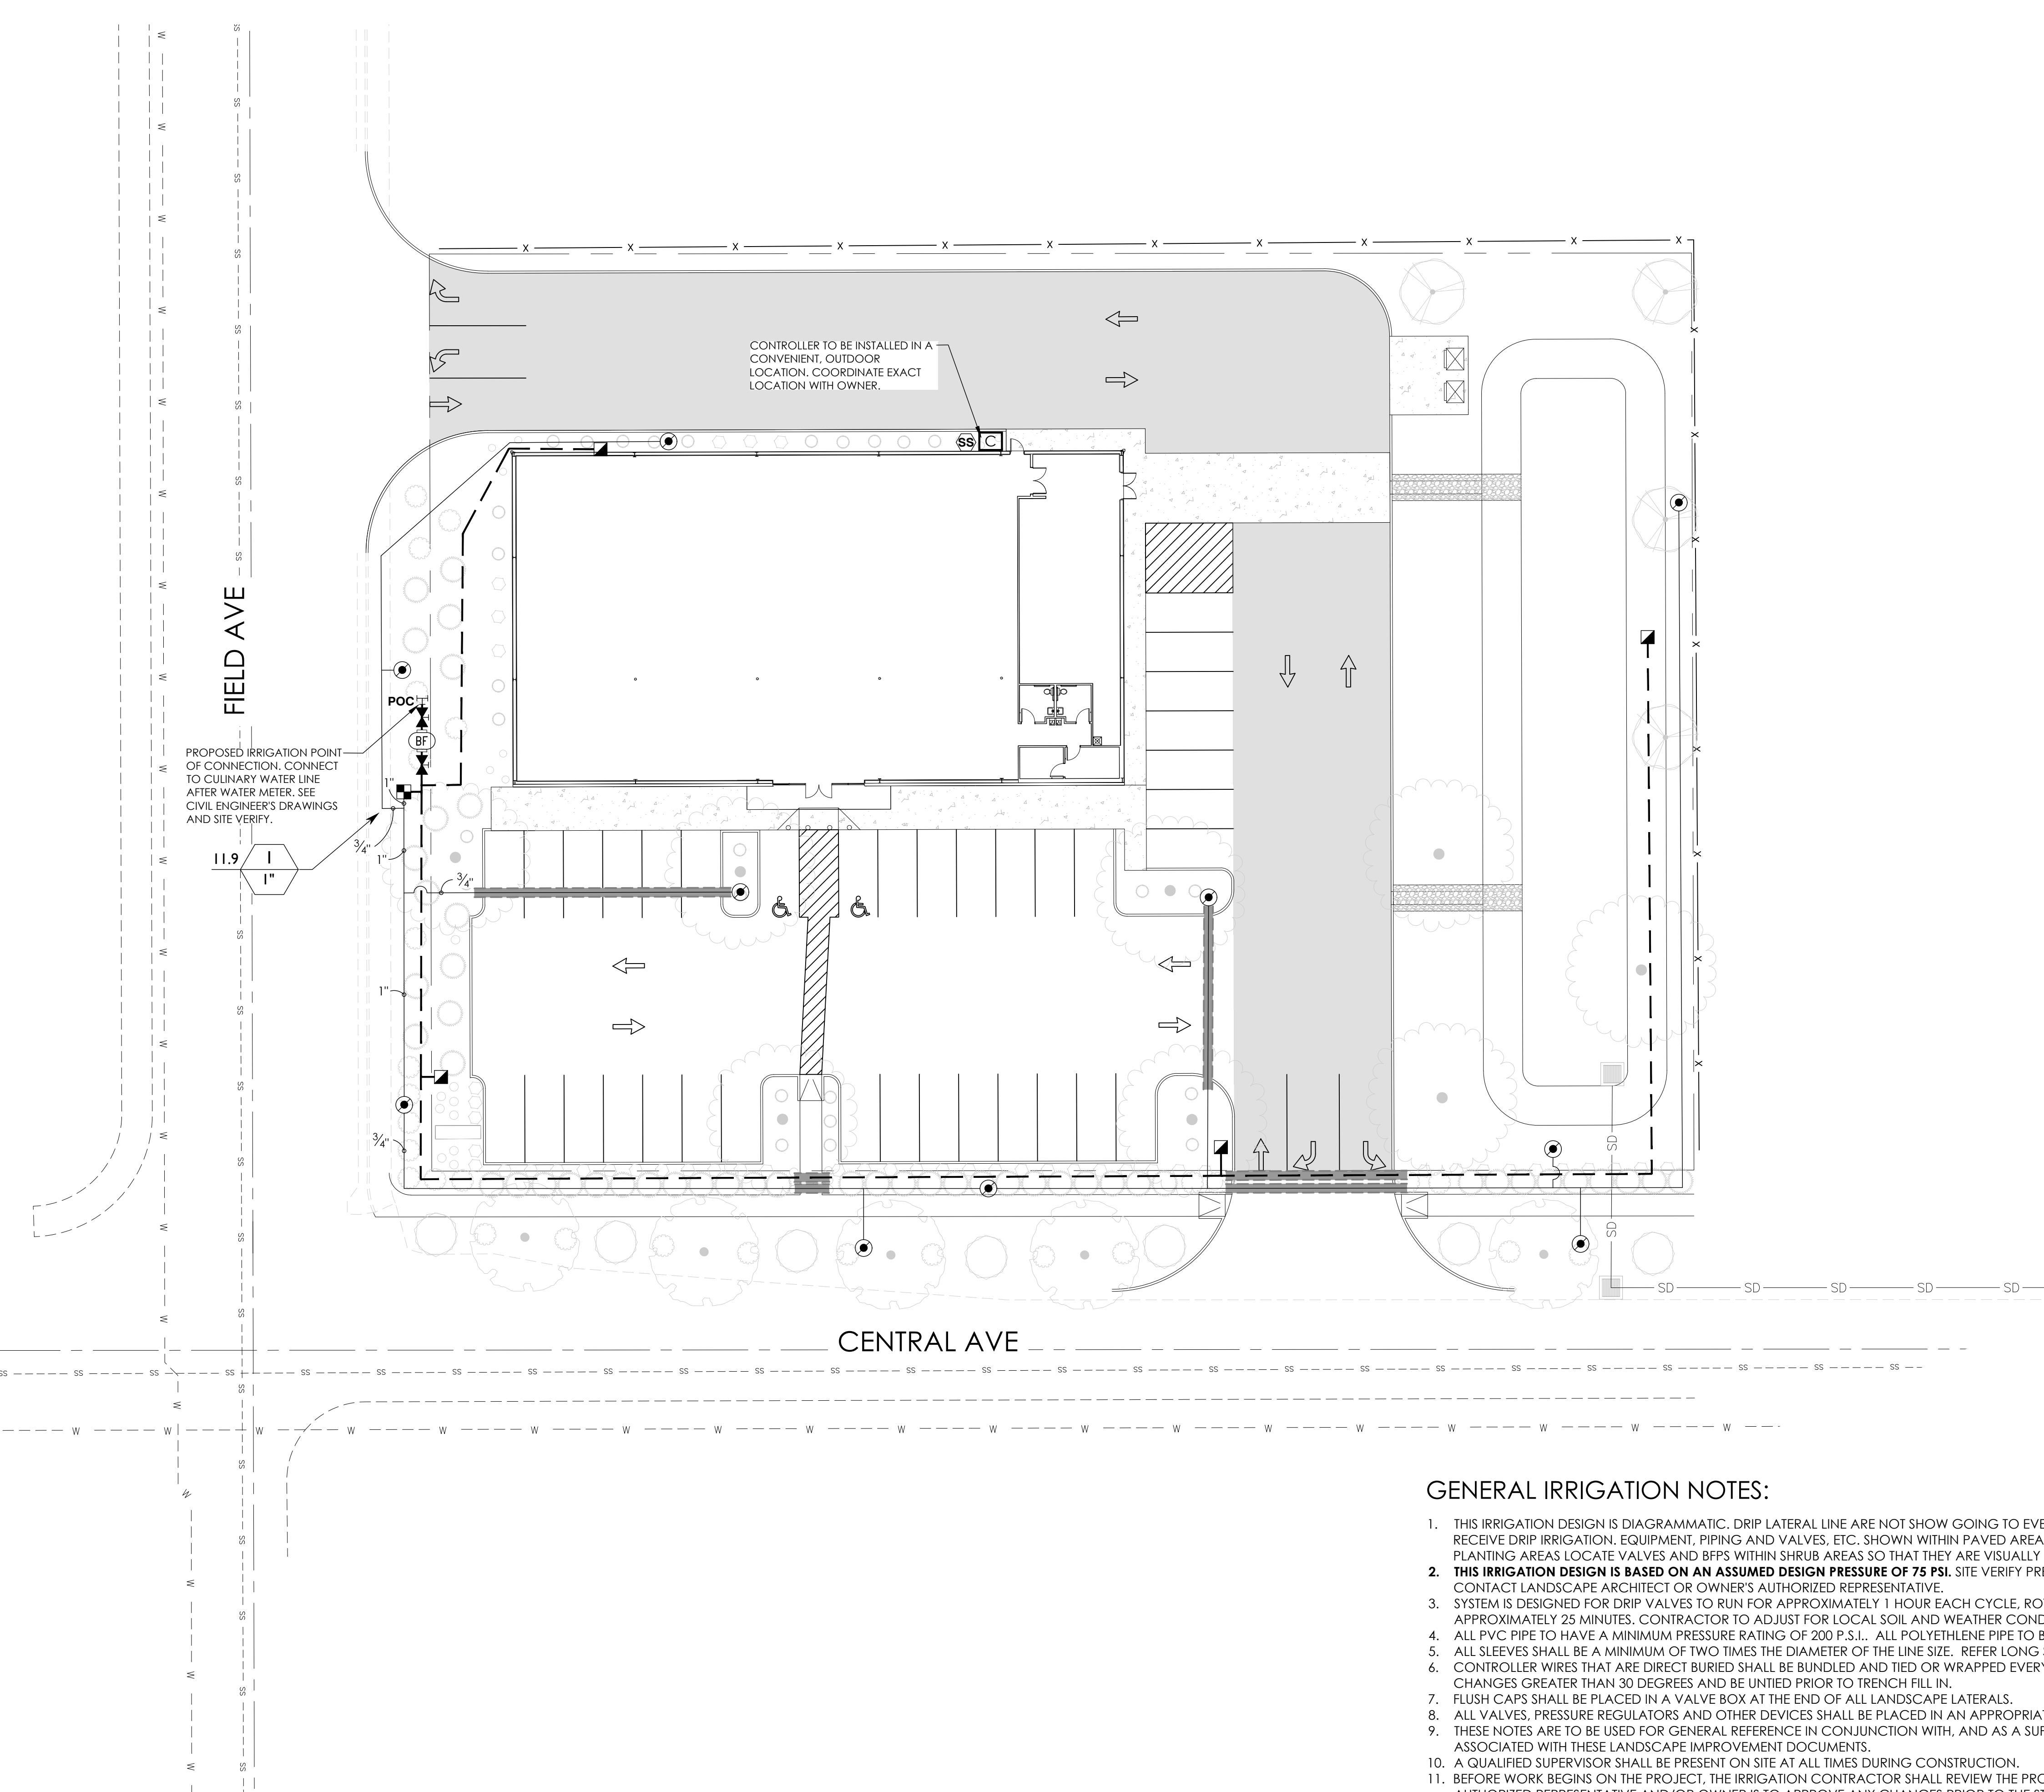


IRRIGATION SCHEDULE

| <u>SYMBOL</u> | <u>MANUFACTURER/MODEL/DESCRIPTION</u> | <u>QTY</u> |
|--|--|--------------|
|  | Hunter ICZ-101-40 1" Drip Control Zone Kit. 1" ICV Globe Valve with 1" HY100 filter system. Pressure Regulation: 40psi. Flow Range: 2 GPM to 20 GPM. 150 mesh stainless steel screen. | 1 |
|  | Pipe Transition Point Transition from underground PVC to above ground connection to 1/2" blank lateral drip tubing. | 10 |
| NOT SHOWN. | Hunter Inline Emitter Tubing | SEE DETAILS. |
| <u>SYMBOL</u> | <u>MANUFACTURER/MODEL/DESCRIPTION</u> | <u>QTY</u> |
|  | Hunter HQ-44LRC 1" Quick coupler valve, yellow rubber locking cover, red brass and stainless steel, with 1" NPT inlet, 2-piece body. | 4 |
|  | Matco-Norca 513T 3/4"-2" Bronze Gate Valve, Full Port, Heavy Duty, Non-Rising Stem. IPS, Wheel Handle. Same size as mainline pipe. | 2 |
|  | Zurn 350XL 1" Double Check Valve Assembly w/ EZSwap insert. | 1 |
|  | Hunter P2C-400 Light Commercial & Residential Controller, 4-station base module controller, 120 VAC, Outdoor/Indoor model. | 1 |
|  | Hunter Solar-Sync Solar, rain freeze sensor with outdoor interface, connects to Hunter PCC, Pro-C, and I-Core Controllers, install as noted. Includes 10 year lithium battery and rubber module cover, and gutter mount bracket. Wired. | 1 |
| POC  | Point of Connection 1" | 1 |
| ————— | Irrigation Lateral Line: PVC Schedule 40 3/4" | 790.9 lf |
| ————— | Irrigation Lateral Line: PVC Schedule 40 1" | 71.7 lf |
| ————— | Irrigation Mainline: PVC Schedule 40 | 639.8 lf |
|  | Pipe Sleeve: PVC Class 200 SDR 21 | 199.3 lf |
| Valve Callout | | |
|  Valve Number Valve Flow Valve Size | | |

GENERAL IRRIGATION NOTES


1. THIS IRRIGATION DESIGN IS DIAGRAMMATIC. DRIP LATERAL LINE ARE NOT SHOW GOING TO EVERY PLANT FOR DESIGN CLARIFICATION ONLY AND THE CONTRACTOR SHALL ENSURE ALL PLANTS RECEIVE DRIP IRRIGATION. EQUIPMENT, PIPING AND VALVES, ETC. SHOWN WITHIN PAVED AREAS ARE SHOWN FOR DESIGN CLARIFICATION ONLY AND SHALL BE INSTALLED WITHIN THE PLANTING AREAS LOCATE VALVES AND BFPs WITHIN SHRUB AREAS SO THAT THEY ARE VISUALLY UNOBTRUSIVE.
2. **THIS IRRIGATION DESIGN IS BASED ON AN ASSUMED DESIGN PRESSURE OF 75 PSI.** SITE VERIFY PRESSURE PRIOR TO BEGINNING WORK. IF PRESSURE IS DIFFERENT THAN ASSUMED PRESSURE, CONTACT LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE.
3. SYSTEM IS DESIGNED FOR DRIP VALVES TO RUN FOR APPROXIMATELY 1 HOUR EACH CYCLE, ROTARY LAWN VALVES FOR APPROXIMATELY 45 MINUTES, AND SPRAY LAWN AREAS FOR APPROXIMATELY 25 MINUTES. CONTRACTOR TO ADJUST FOR LOCAL SOIL AND WEATHER CONDITIONS.
4. ALL PVC PIPE TO HAVE A MINIMUM PRESSURE RATING OF 200 P.S.I.. ALL POLYETHYLENE PIPE TO BE PE3408 RECLAIMED WATER PIPE.
5. ALL SLEEVES SHALL BE A MINIMUM OF TWO TIMES THE DIAMETER OF THE LINE SIZE. REFER LONG SWEEP NOTE.
6. CONTROLLER WIRES THAT ARE DIRECT BURIED SHALL BE BUNDLED AND TIED OR WRAPPED EVERY TWELVE (12') FEET. DURING INSTALLATION WIRES SHALL HAVE A 24" LOOP TIED AT ALL DIRECTION CHANGES GREATER THAN 30 DEGREES AND BE UNTIED PRIOR TO TRENCH FILL IN.
7. FLUSH CAPS SHALL BE PLACED IN A VALVE BOX AT THE END OF ALL LANDSCAPE LATERALS.
8. ALL VALVES, PRESSURE REGULATORS AND OTHER DEVICES SHALL BE PLACED IN AN APPROPRIATELY SIZED VALVE BOX WITH A MINIMUM OF 2" OF PEA GRAVEL.
9. THESE NOTES ARE TO BE USED FOR GENERAL REFERENCE IN CONJUNCTION WITH, AND AS A SUPPLEMENT TO THE WRITTEN SPECIFICATIONS, APPROVED ADDENDA, AND CHANGE ORDERS ASSOCIATED WITH THESE LANDSCAPE IMPROVEMENT DOCUMENTS.
10. A QUALIFIED SUPERVISOR SHALL BE PRESENT ON SITE AT ALL TIMES DURING CONSTRUCTION.
11. BEFORE WORK BEGINS ON THE PROJECT, THE IRRIGATION CONTRACTOR SHALL REVIEW THE PROJECT WITH THE OWNER'S AUTHORIZED REPRESENTATIVE AND/OR OWNER. THE OWNER'S AUTHORIZED REPRESENTATIVE AND/OR OWNER IS TO APPROVE ANY CHANGES PRIOR TO THE START OF ANY WORK.
12. IRRIGATION CONTRACTOR SHALL INSPECT WITH THE OWNER'S AUTHORIZED REPRESENTATIVE AND/OR OWNER ALL EXISTING CONDITIONS PRIOR TO THE START OF ANY WORK. THE CONTRACTOR SHALL BE RESPONSIBLE UNDER THIS CONTRACT TO REPAIR AND/OR REPLACE, AT THEIR OWN EXPENSE, ANY STRUCTURES, FENCES, WALLS, PLANT MATERIAL, OR OTHER ITEMS DESTROYED DURING CONSTRUCTION. LIKEWISE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING AND/OR REPLACING ANY AND ALL DAMAGES TO ADJACENT PROPERTIES OR ANY OTHER AREAS OUTSIDE THE CONTRACT LIMITS. THE DAMAGED ITEMS/AREAS WILL BE RESTORED TO THEIR ORIGINAL CONDITION TO THE SATISFACTION OF THE OWNER'S AUTHORIZED REPRESENTATIVE AND/OR OWNER.
13. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE ALL IRRIGATION LOCATIONS WITH OTHER TRADES PRIOR TO INSTALLATION. THE CONTRACTOR SHALL FAMILIARIZE THEMSELVES WITH THE LOCATIONS OF EXISTING AND FUTURE UNDERGROUND SERVICES AND IMPROVEMENTS WHICH MAY CONFLICT WITH THE WORK TO BE DONE. PRIOR TO THE START OF WORK, ALL UNDERGROUND UTILITIES ARE TO BE LOCATED AND PROTECTED. CONTRACTOR IS RESPONSIBLE FOR THE INITIAL CALL AND FUTURE UPDATES TO BLUE STAKES AT 622-4111.
14. ALL HARDCAPE, WALLS, SIGNAGE, AND HEADER MUST BE STAKED AND APPROVED BY THE OWNER'S AUTHORIZED REPRESENTATIVE PRIOR TO CONSTRUCTION.
15. VERIFY CRITICAL DIMENSIONS, REFERENCE POINT LOCATIONS, AND CONSTRUCTION CONDITIONS PRIOR TO INITIATING CONSTRUCTION. NOTIFY THE OWNER AND LANDSCAPE ARCHITECT SHOULD CONFLICTS ARISE.
16. IRRIGATION CONTRACTOR SHALL PROVIDE BARRICADES AND TRAFFIC CONTROL ALONG PUBLIC STREETS IF REQUIRED DURING CONSTRUCTION.

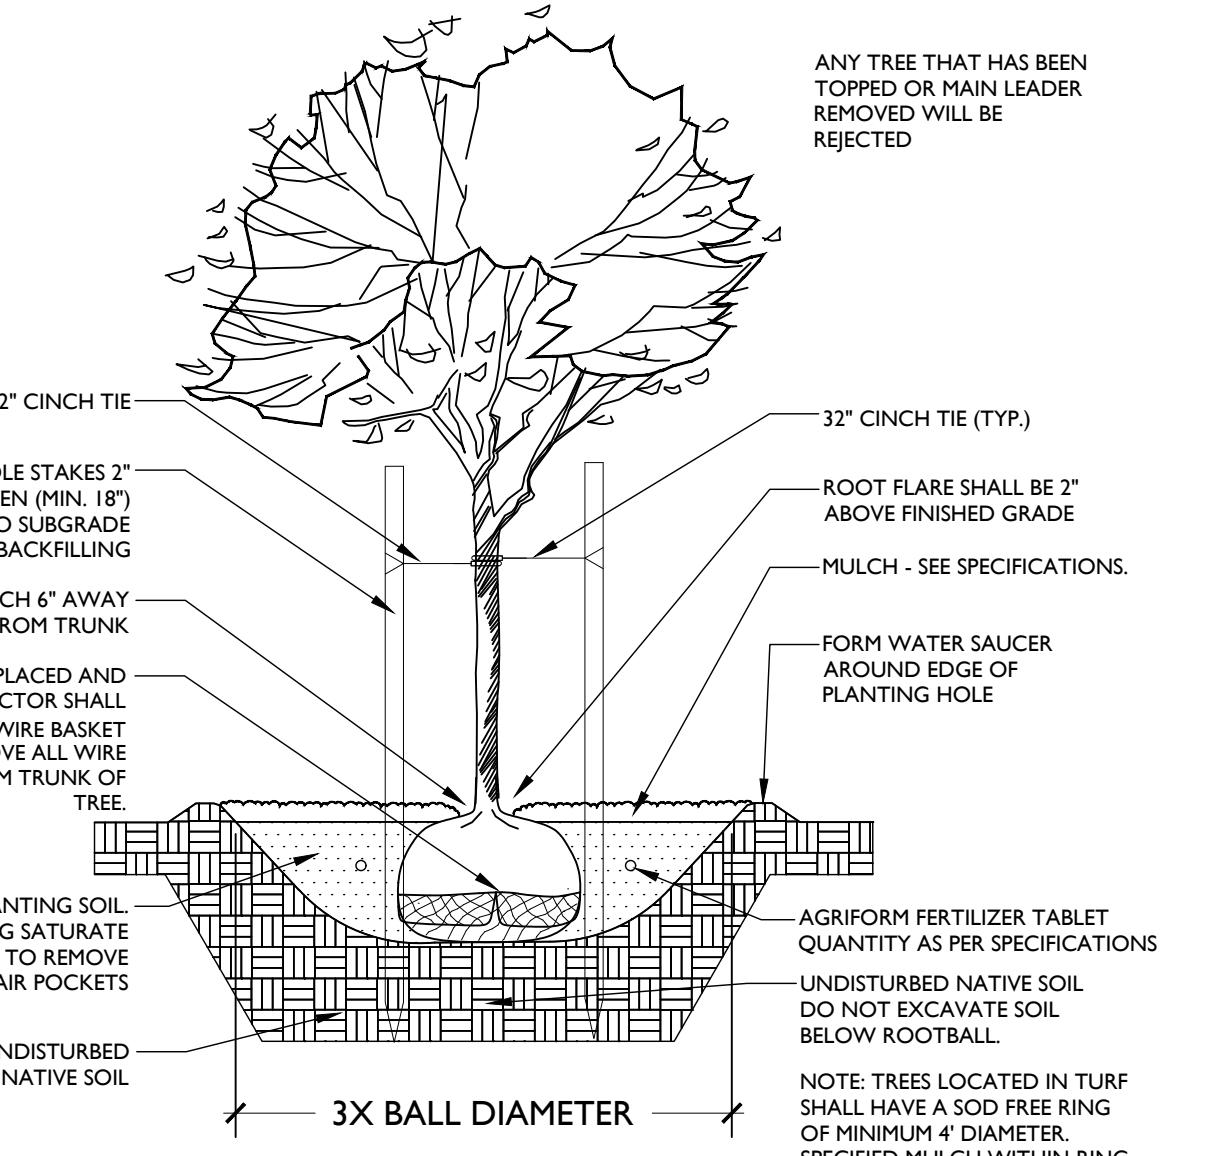

DECIDUOUS TREE PLANTING

$$/8'' = 1'-0''$$


P-BF-BAS-01

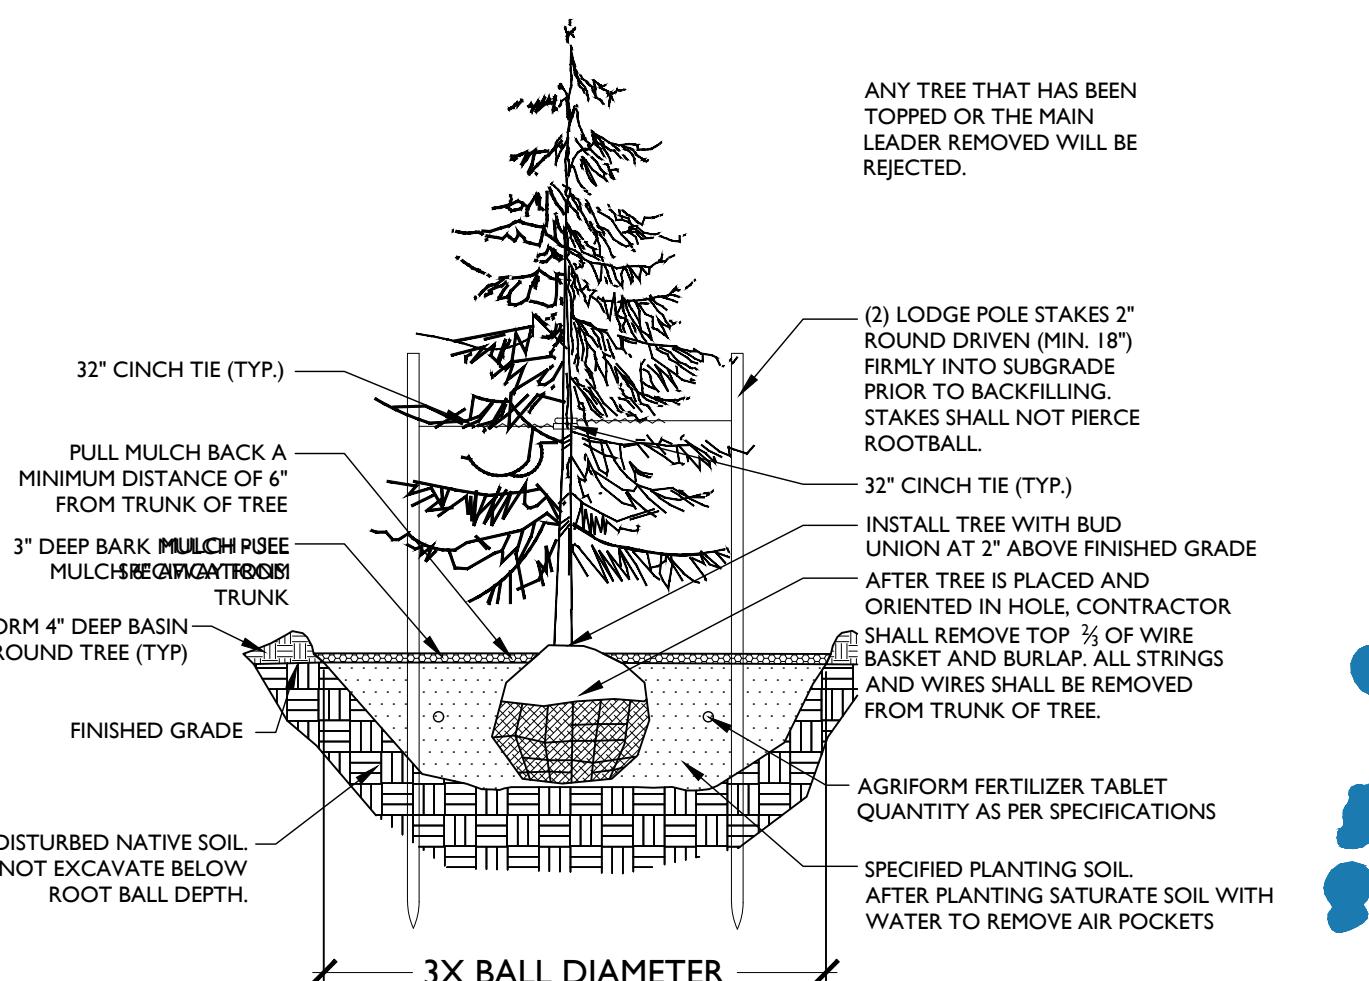

EVERGREEN TREE PLANTING

(2") 1' (2")

B BE BAS 03

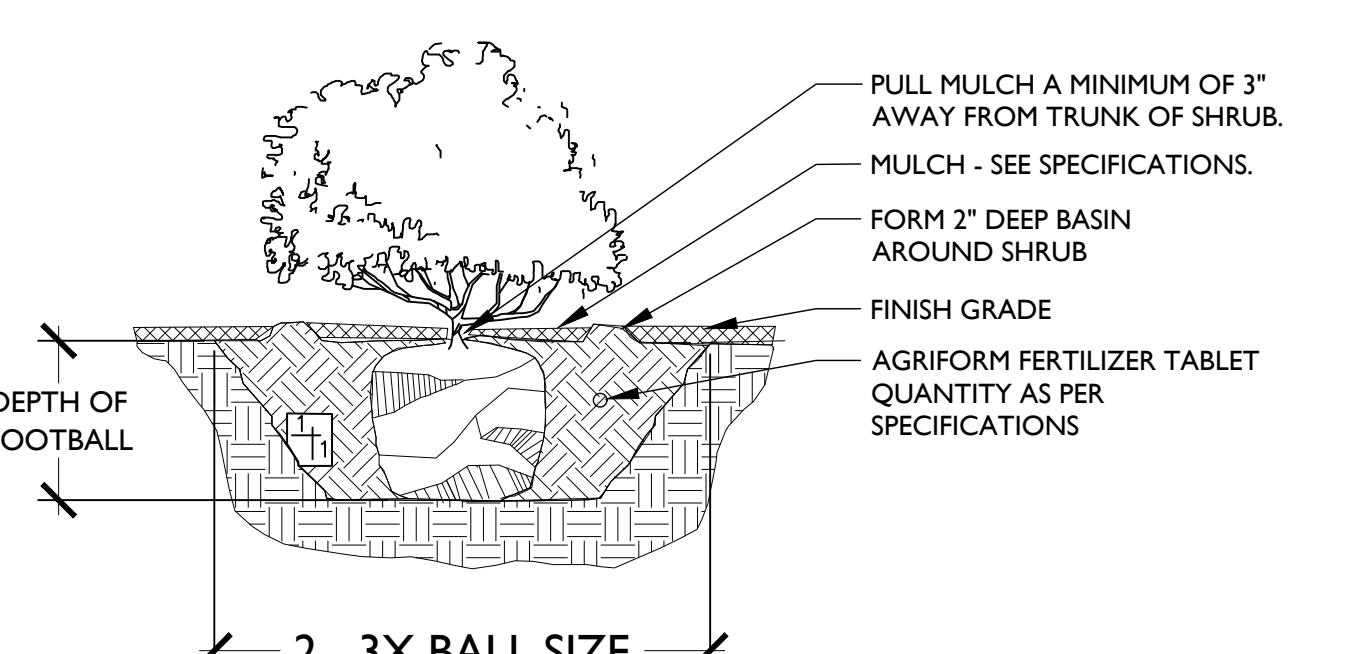

SHRUB PLANTING


100% *renewable* energy

ATTENTION: PRIOR TO PERFORMING ANY WORK ON THIS PLAN CONTRACTOR SHALL IDENTIFY THROUGH BLUESTAKES AND ON-SITE OBSERVATION ANY AND ALL UTILITIES AND HAZARDS OR CONDITIONS THAT MAY PREVENT WORK BEING PERFORMED ACCORDING TO THESE PLANS ABOVE OR BELOW GROUND. IF CONDITIONS ARE FOUND THAT MAY PREVENT WORK FROM BEING PERFORMED AS PER PLAN, CONTRACTOR SHALL CONTACT LANDSCAPE ARCHITECT TO PROCEEDING. ANY DAMAGE TO UTILITIES SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY (I.E. ELECTRICAL, GAS, WATER,SEWER, ETC.). EVERY EFFORT HAS BEEN MADE TO ENSURE ACCURACY WITH THESE DRAWINGS. QUANTITIES LISTED ARE FOR REFERENCE ONLY. CONTRACTOR SHALL VERIFY ALL MEASUREMENTS AND QUANTITIES ON THESE PLANS. ARCHITECT SHALL NOT BE RESPONSIBLE FOR DISCREPANCIES BETWEEN QUANTITIES LISTED IN LEGENDS AND PLANS WHERE DISCREPANCIES EXIST BETWEEN SPECIFICATIONS, DETAILS, AND/OR DRAWINGS, CONTRACTOR SHALL CONTACT LANDSCAPE ARCHITECT PRIOR TO PROCEEDING. CONTRACTOR SHALL INSPECT THE SITE TO VERIFY THAT DRAWINGS ARE CONSISTENT WITH SURVEYED BASE INFORMATION. DURING CONSTRUCTION IF DISCREPANCIES ARE FOUND BETWEEN THESE PLANS AND THE SITE, CONTRACTOR SHALL CONTACT THE LANDSCAPE ARCHITECT PRIOR TO PROCEEDING.

ENG/ARCH:
DRAWN BY: RAB
REVIEWED BY: RAB

DATE: 28 Mar 2025


7

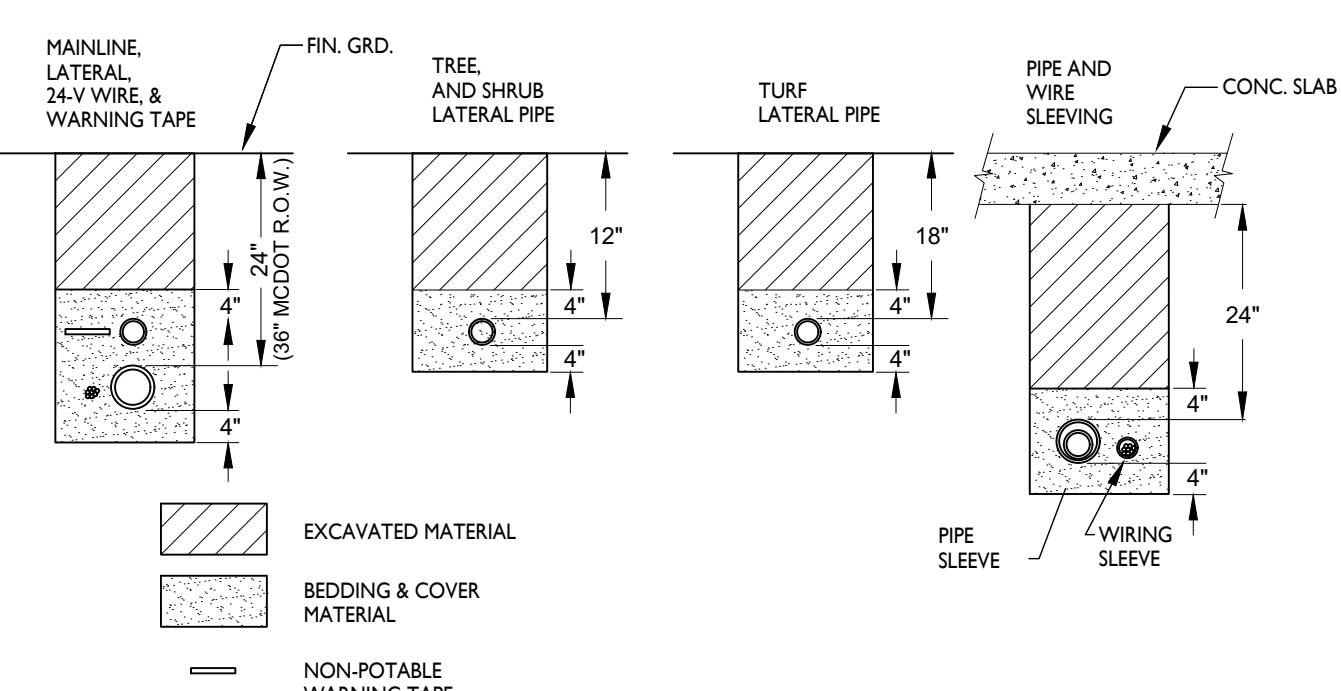

NOTES:
SLEEVE ALL PIPE AND WIRE SEPARATELY.
ALL PIPE TO BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. "SNAKE" UNSLEEDED PLASTIC PIPE IN TRENCH. PROVIDE A MIN. OF 2" CLEARANCE TO SIDE OF TRENCH AND BETWEEN PIPES.
ALL 120V WIRING SHALL BE INSTALLED IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS. TAPE AND BUNDLE 24V WIRE EVERY 10' AND PROVIDE LOOSE 20' LOOP AT ALL CHANGES OF DIRECTION OVER 30 DEGREES.
ALL IRRIGATION MAINLINE WITHIN 5' FROM BACK OF CURB SHALL BE INSTALLED WITH A MINIMUM OF 36" DEPTH OF COVER (MCDOT RIGHT-OF-WAY).
LAY NON-POTABLE WARNING TAPE 6-INCHES ABOVE MAINLINE.


8 PIPE TRENCH LAYOUTS

1 1/2" = 1'-0"

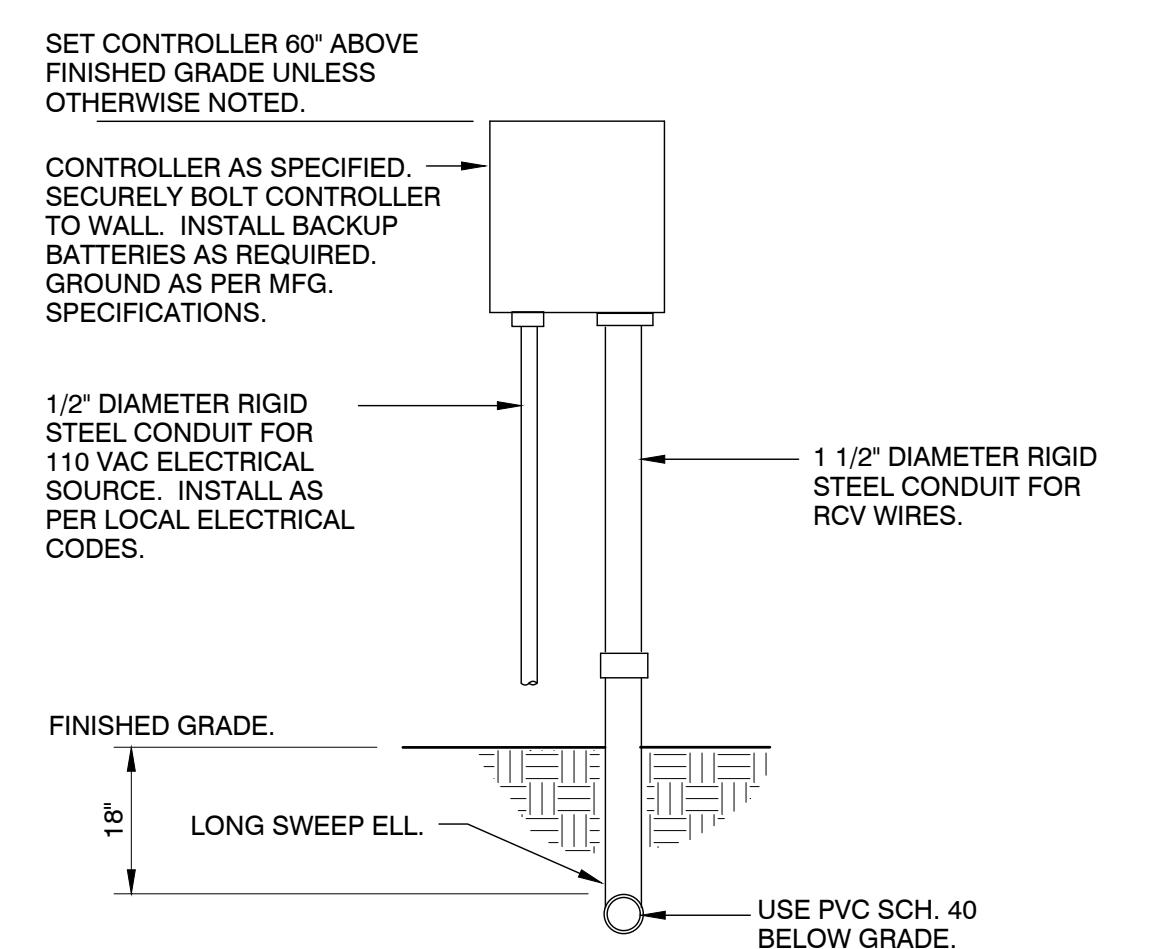


4 WALL MOUNT CONTROLLER

P-CO-QQS3-16

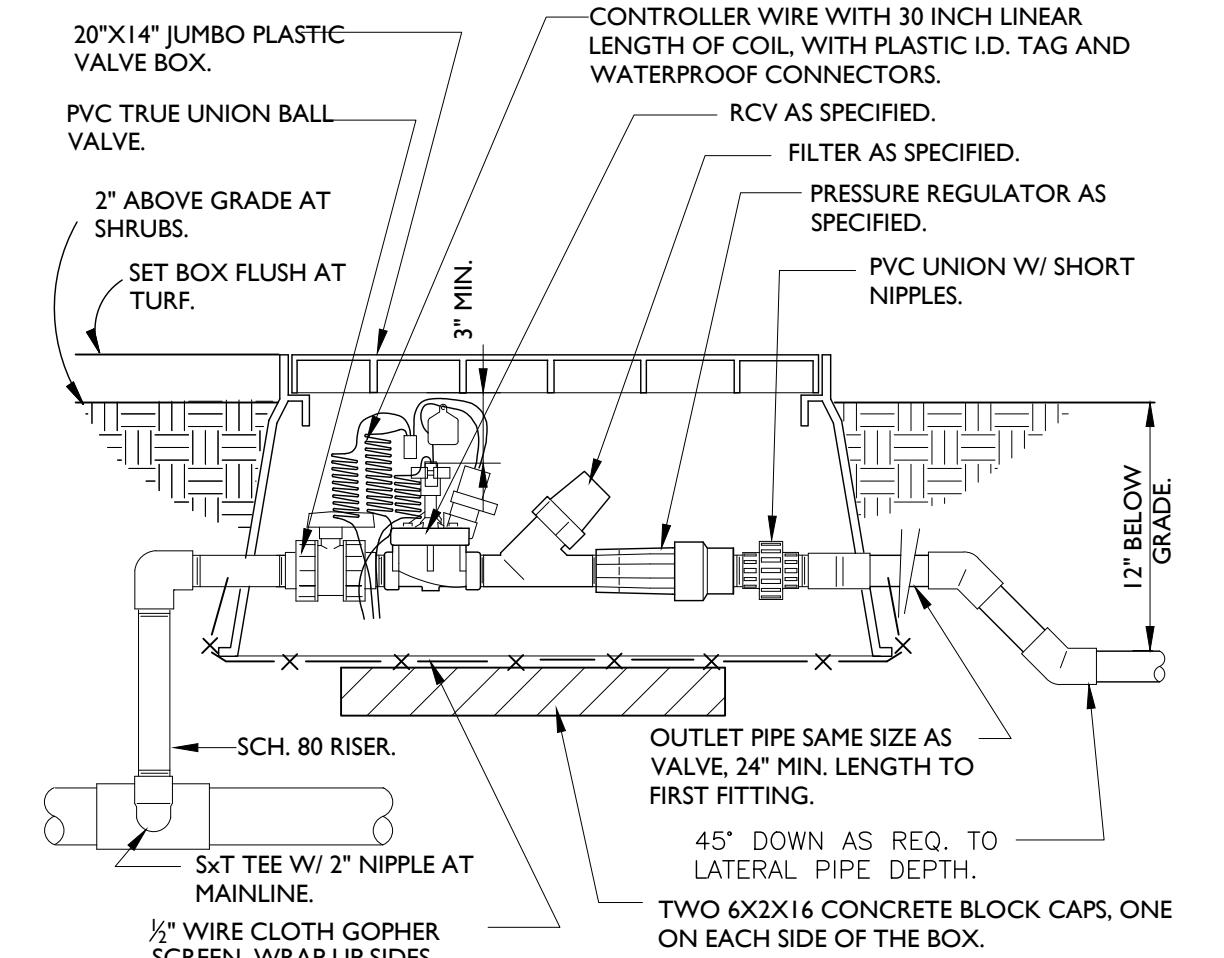


1 DRIP VALVE KIT

1 1/2" = 1'-0"

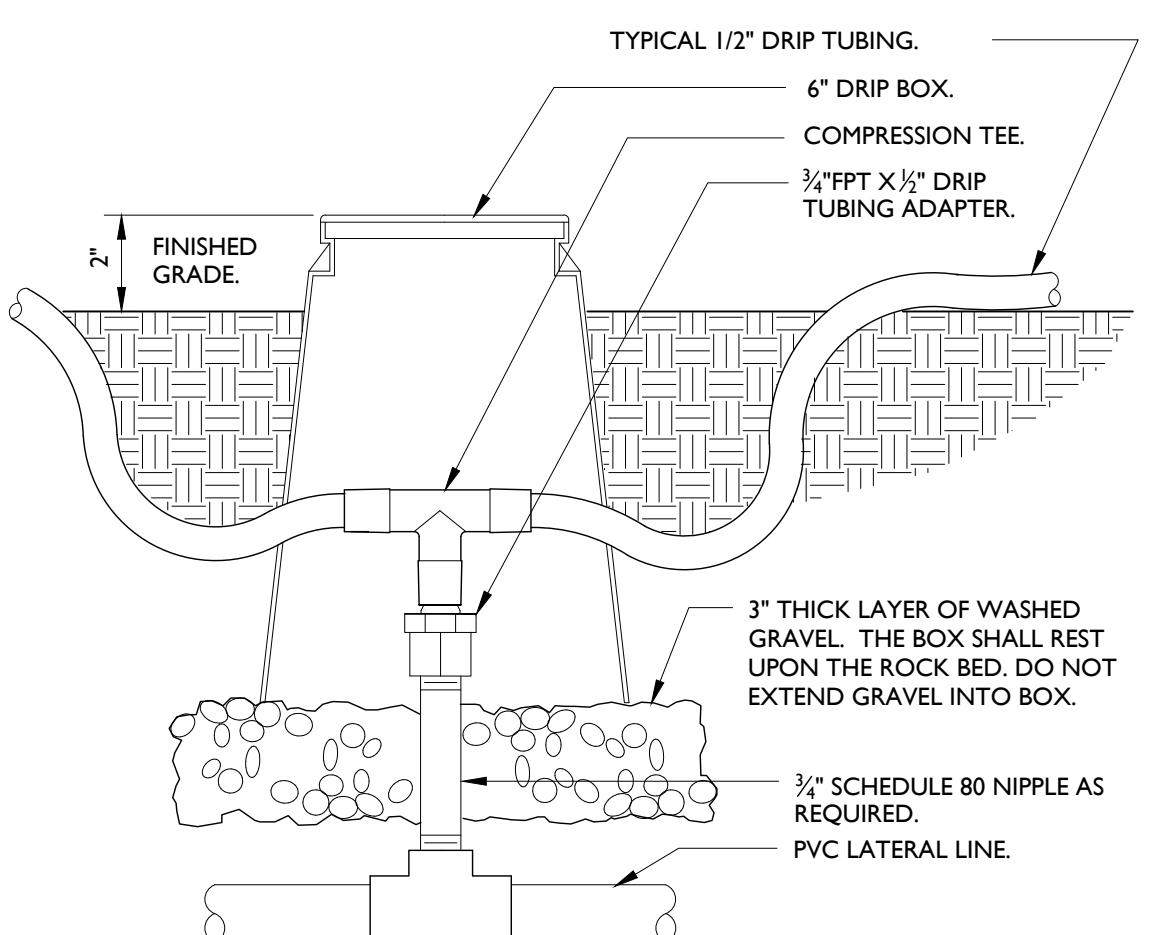


9 PIPE TRANSITION POINT

3" = 1'-0"

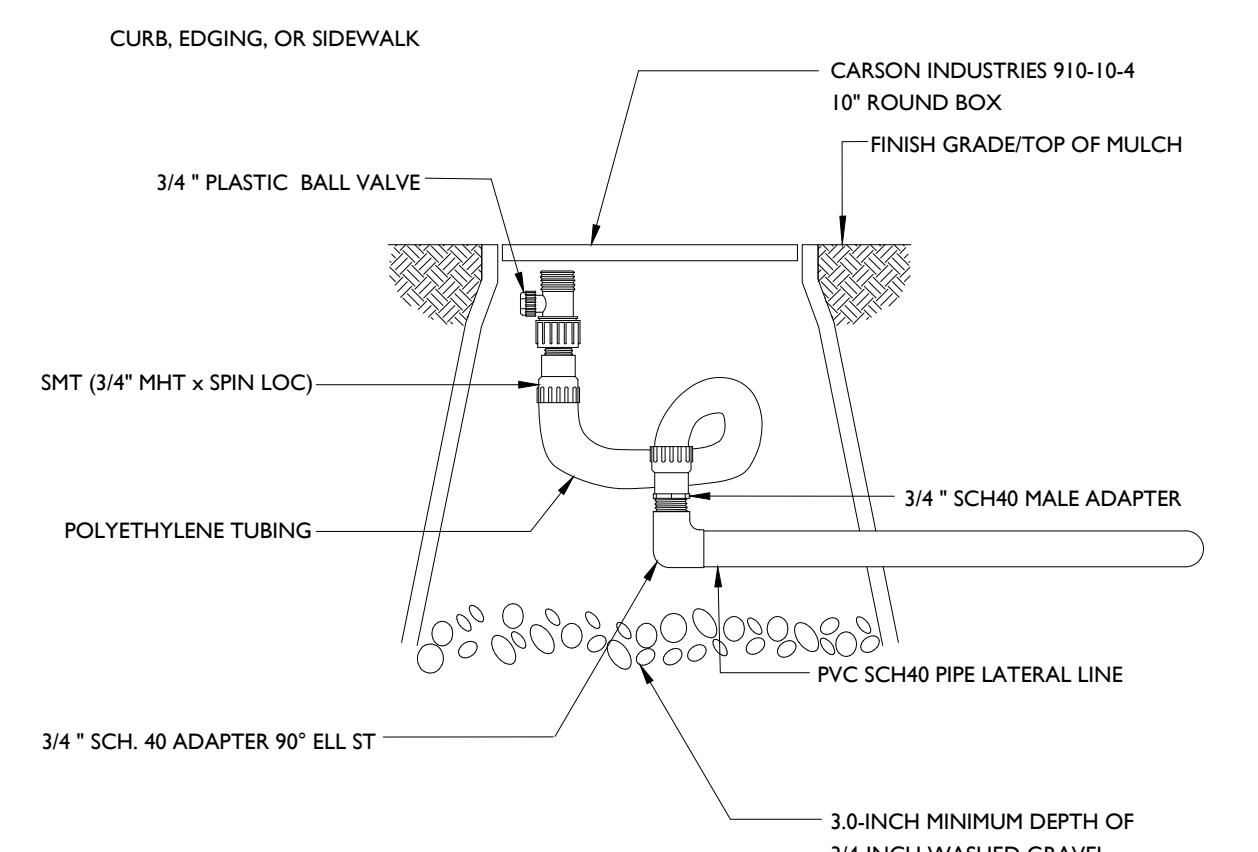


10 LATERAL FLUSH ASSEMBLY

3" = 1'-0"

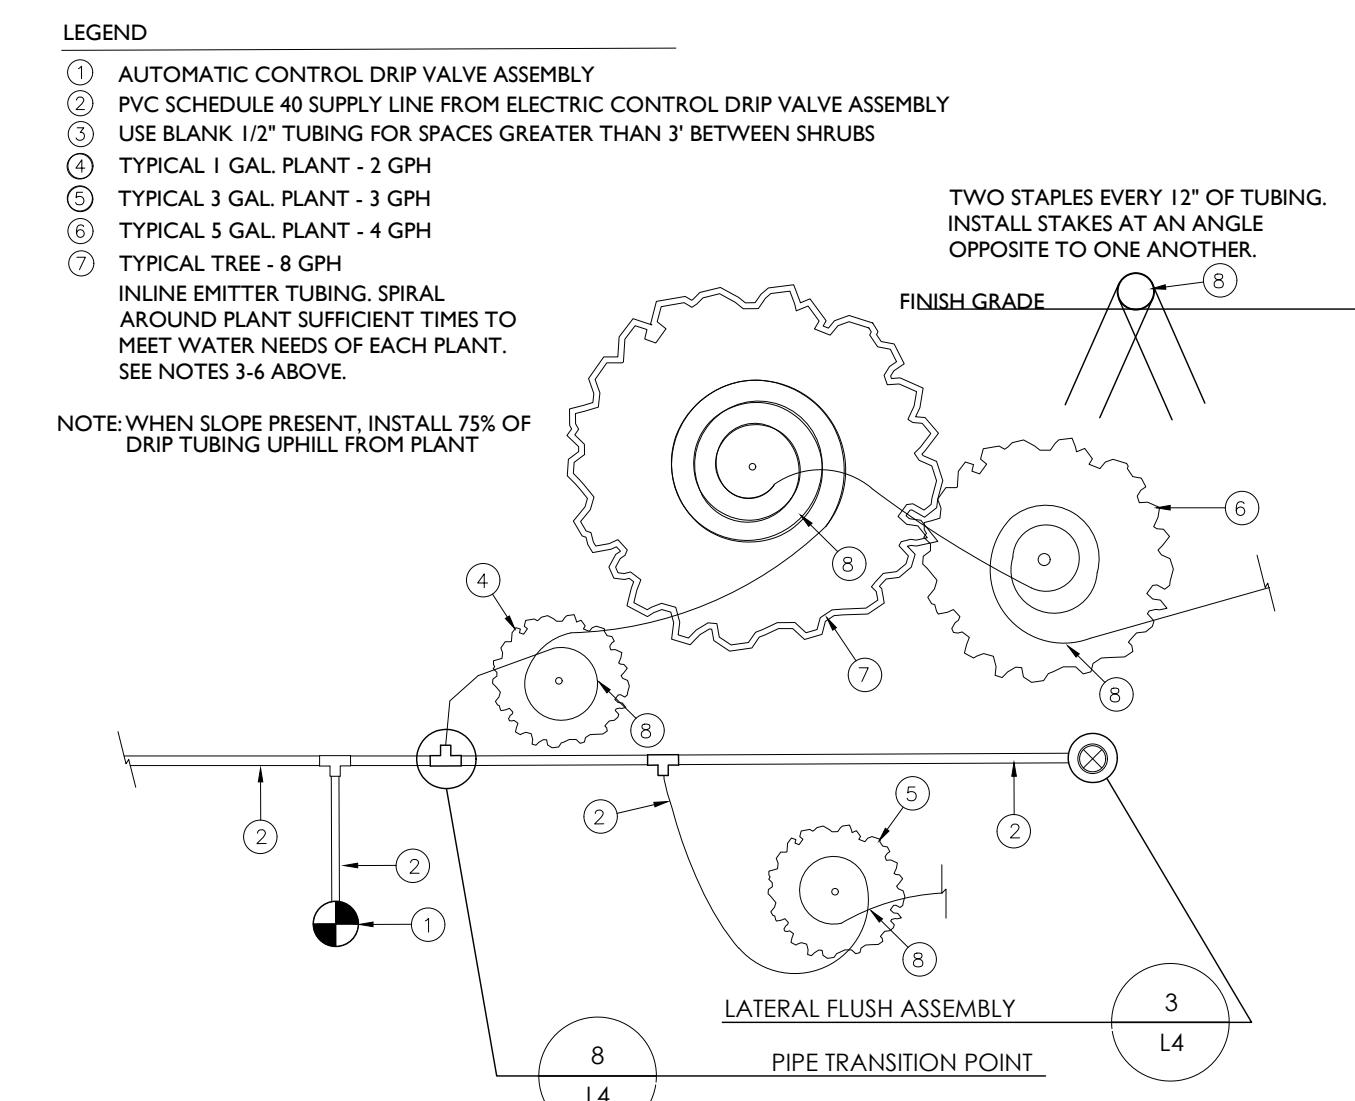


5 TYPICAL DRIPLINE LAYOUT

1 1/8" = 1'-0"

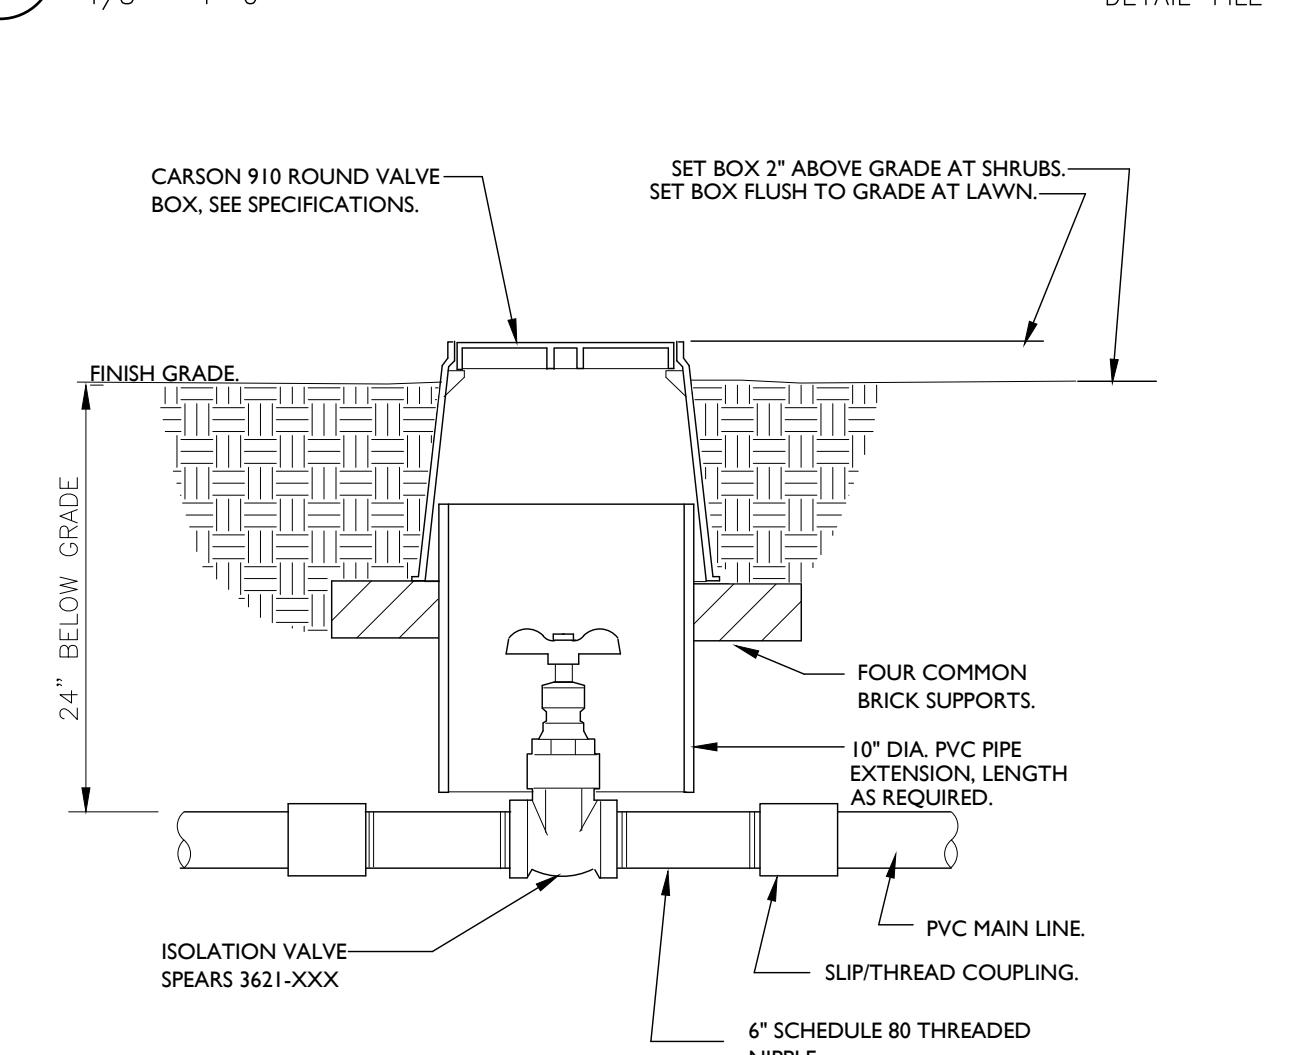


6 MANUAL ISOLATION VALVE

1 1/2" = 1'-0"

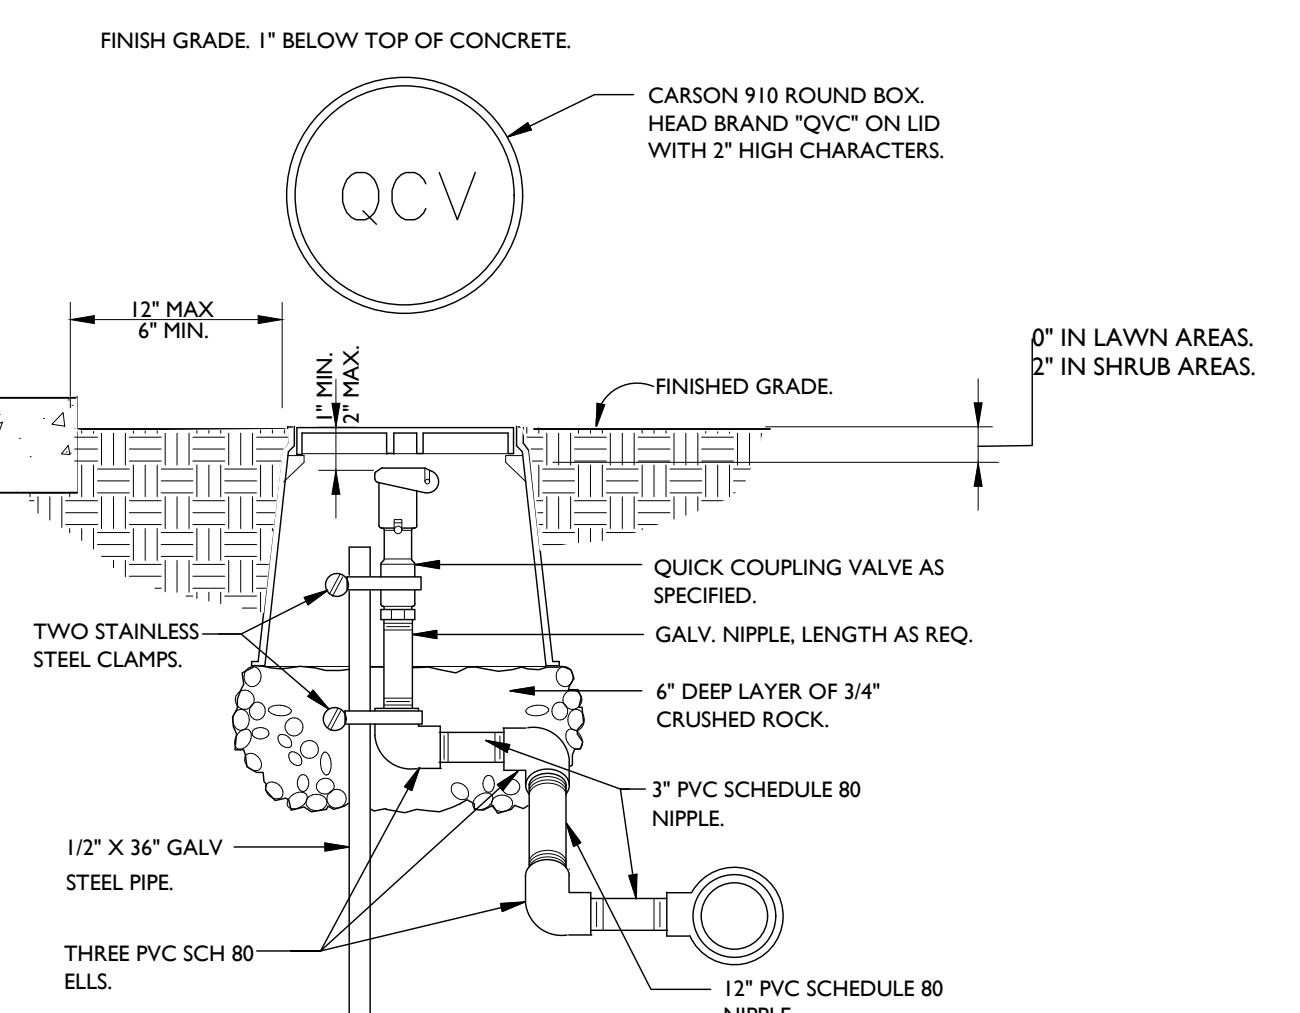

3 QUICK COUPLER VALVE IN BOX

1 1/2" = 1'-0"

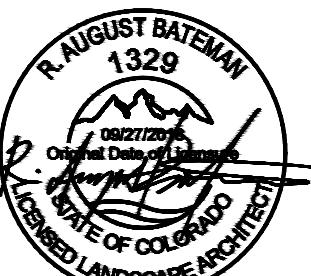

NOT USED.



SECTION 1 - PLANT MATERIAL

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Work as evident on drawings and specified herein or required to complete all landscaping and shall include, but not necessarily limited to the following work:
 - 1. Furnish imported topsoil from outside sources as needed (see sub-section 2.01).
 - 2. Ensure all necessary permits are obtained prior to construction and staging.
 - 3. Excavate tree/shrub pits.
 - 4. Provide and plant all materials indicated on plan and plant list.
 - 5. Stake and protect all trees and planted areas as specified and detailed.
 - 6. Clean all areas prior to Acceptance of the Work, including debris, stains, and dirt from walks and other surfaces.
 - B. These specifications are complementary to the drawings.

SECTION 2 - Turf Sod and Soil Preparation

1.02 QUALITY ASSURANCE

- A. Regulatory Requirements
 - 1. Comply with applicable requirements of Federal, State and Local laws, regulations and codes having jurisdiction at the project site.
- Contractor shall be responsible for certificates of inspection of plant material that may be required by Federal and Local authorities to accompany shipments of plants.

Reference Standards

- 1. "Standardized Plant Name" by the American Joint Committee of Horticultural Nomenclature.
- 2. "American Standard of Nursery Stock" by the American Association of Nurserymen.
- 3. American National Standards Institute (ANSI) Publication 260.1.

C. Substitutions

- 1. Substitutions of plant material will not be permitted unless authorized in writing by the Landscape Architect. If proof is submitted that any plant specified is not obtainable, a proposal will be considered for use of the nearest equivalent size or variety with corresponding adjustment of Contract Price. Such proof shall be substantiated and submitted in writing to the Landscape Architect at least thirty (30) days prior to start of the work under this Section. These provisions shall not relieve Contractor of the responsibility of obtaining specified materials in advance if special growing conditions or other arrangements must be made in order to supply specified materials.

Source Quality Control

- 1. Plants shall be subject to inspection and approval by the Landscape Architect/Owner at place of growth and upon delivery for conformity to specifications. Such approvals shall not impair the right of inspection and rejection during progress of the Work. Submit written request for inspection of plant material at place of growth and quantity of plants to be inspected. The Landscape Architect reserves the right to refuse inspection at this time if, in his judgement, a sufficient quantity of plants is not available for inspection.
- 2. All plants may be inspected at the nursery by the Landscape Architect or Owner and shall be tagged with self-locking tags. Plants delivered to the site without these tags or with broken tags shall be sufficient reason for rejection.

Contractor's Qualifications

- 1. All bidders shall be required to present proof of their qualifications, contract sample, Utah state licensure, insurance coverage, experience, and ability to perform the scope of work set forth in these specifications according to the following construction deadlines pending unforeseen delays related to the weather or other conditions outside the contractors control.

1.03 PROJECT PERSONNEL AND SITE PROTECTION

ATTENTION:

- The Contractor shall have a designated foreman in direct and personal charge of the work, and the foreman shall be on the job at least eighty-five (85) percent of the working hours. The Owner's Authorized Representative may "shut down" the work under contract if the supervisor is not, in his opinion, adequate to protect the interests of the Owner. Such "shut down" time to be counted as working days and will not extend the time of the contract.

- All existing site elements including but not limited to the following shall be protected: All existing utilities, existing landscapes (drives/curbs/walks/patios), etc. shall be protected from impact damage of any sort, staining from leaky trucks or equipment, or other damage.

1.04 PACKAGING, DELIVERY, STORAGE AND HANDLING

- A. Plants shall be properly marked for identification and for checking. Each block of plants and at least 25% of each variety of separate plants in any one shipment shall have legible labels securely attached upon delivery to the site.

Product Handling:

- During hot weather and when practical, the contractor may be required to transport plant materials between sunset and sunrise if transported in an open trailer or un-refrigerated box.

- Dug material should be maintained and watered as required at the nursery to guarantee their vitality and health until shipping.

- Protected all trunks, stems, branches, and root balls during tree tying, wrapping and loading operations from damage.

- Load balls or containers onto transport vehicle and secure in a manner that protects the structural integrity of the root balls.

- The contractor shall be solely responsible for the safe transportation of plants to the site and their condition upon arrival. Trees damaged, dehydrated, or suffered during transit or storage will be rejected.

- Plant materials shall not be stored on concrete or asphalt or left exposed to the sun.

- Roots and balls of plants shall be adequately protected at all times from the sun and drying winds.

- The Landscape Architect may inspect any phase of this operation and may reject any plant material improperly handled during any phase of this operation.

- Nothing in this Section shall be interpreted as relieving the contractor of the responsibility of providing healthy, viable plants, nor shall it have any effect upon the terms of the warranty specified herein.

- Deliver packaged materials in containers showing weight, analysis and name of manufacturer. Protect materials from deterioration during delivery, and while stored at the site.

- Delivery and plantings, storage of dry bulk materials and other shall be coordinated with project General Contractor to ensure appropriate staging area. Protect dry bulk materials from inclement weather conditions such as wind and moisture.

1.06 SUBMITTALS

- A. Furnish two (1') copies of manufacturer's literature, plans, samples, certifications, delivery tickets, or laboratory analytical data for approval by the Landscape Architect prior to commencement of all work under this contract for the following items:

- 1. Specified granular and tablet fertilizers (certification, rate of application and number to tablets per plant pt)
- 2. Weed control, Pre-emergent and anti-desiccant (certification)
- 3. Tree guys (literature)
- 4. Sodded Turf (literature and Delivery Ticket)
- 5. Lawn Edging (literature) See plan.
- 6. Stone Mulch (sample)

- Submit proposed plant placement schedule to owner, indicating dates for each type of landscape work during normal seasons for such work in area of site. Once accepted, revise dates only as approved in writing, after documentation of reasons for delay.

1.07 PROJECT WARRANTY

- A. Warranty trees and other plant materials, for a period of one year after date of substantial completion, against defects including death and unsatisfactory growth, except for defects resulting from neglect by Owner, abuse or damage by others, or unusual phenomena or incidents which are beyond Landscape Installer's control.

- B. Remove and replace trees or other plants found to be dead or in unhealthy condition during warranty period. Replace trees or other plants that are in doubtful condition at end of warranty period; unless, in opinion of Architect, it is advisable to extend warranty period for a full growing season.

- C. All replacements shall be plants of the same kind, size, and quality as originally specified and they shall be furnished, planted, guyed and maintained as specified at no additional cost.

- D. Another inspection shall be conducted at end of extended warranty period to determine acceptance or rejection. Only one replacement (per tree or plant) will be required at end of warranty period, except for losses or replacements due to failure to comply with specified requirements.

PART 2 - PRODUCTS

2.01 SOIL, SOIL AMENDMENTS

A. Topsoil is stockpiled on site for contractor use.

Contractor shall ensure the following amount of topsoil is found in all planter and lawn areas over a non-compacted sub-grade

- Lawn Areas: 6 inch depth.
- Planter Areas: 12 inch depth.

Contractor shall have agronomy soils test performed or provide a soil certificate for proposed imported soil. Test results shall be submitted to the Landscape Architect for review prior to placement. Contractor shall obtain test results from obtained from well-drained, stable land and shall be free from sub-soil, refuse, roots, heavy or stiff clay, stones 1 inch and larger in largest dimension, coarse sand, sticks, brush, litter, and other deleterious substances. Amend soil as needed to meet the "ideal" parameters in the chart below.

| Soil Parameter | Acceptable | Ideal | Non Ideal - Possibly Toxic | Note |
|--|--|--|----------------------------|---|
| pH | 5.5-8.4 | 6.0-7.5 | <5.5 and >8.5 | low pH corrected by addition of lime. High pH can give an amount needed, high pH difficult to correct. Unstable soil/soluble problems if any and deal with fertility issues caused by high pH |
| EC, dS/m | <2.5 | <1.0-1.5 | >4.0-6.0 | lower salt content by leaching with good quality water (soil/soluble salts) |
| CaCO ₃ (calcium carbonate), % | <10 | <1 | >30-80 | difficult to correct; generally requires more phosphorus and some micronutrient fertilizers |
| SAT ² (ESP) | <8 (10) | <4 (5) | >11 (14) | lower by addition of gypsum or similar (lab can give amounts needed) |
| OM, % | >1.0 | >1.0 | N/A | |
| EC ³ , ppm | <300 | <750 | >750 | |
| SIL/CA ratio | >2 (total of two is 25-30% (ratio is not critical if outside this range) | 15-25 | N/A | |
| CEC ⁴ | >12 | red, brown, black (w/ol gray & yellow) | N/A | |
| Aggregate (20mm) stability, not dispersed (cloudy) | >1 hour | >2 hours | N/A | |
| Subsoil drainage rate | >0.2 in/hour | >0.6 in/hour | <0.1 in/hour | difficult to correct; select different soil |
| Bulk Density, g/cm ³ | 1.3-1.6 | 1.3-1.5 | >1.7-1.8 | correct with tillage, but does not always correct permanently. see EC |
| NH ₄ ⁵ , ppm | any | any | any | add fertilizer to meet plant needs |
| P- Boronate, ppm | any | 10-60 ppm | N/A | add fertilizer to meet plant needs. If P is high - environmental problems |
| P- Bray P ₁ (only nonalkaline) | any | 20-80 ppm | N/A | add fertilizer to meet plant needs. If P is high - environmental problems |
| P- Mehlich 3 (ppm only nonalkaline) | any | 22-90 ppm | N/A | add fertilizer to meet plant needs. If P is high - environmental problems |
| K, ppm | 150-300 | >300 | N/A | add fertilizer to meet plant needs |
| Ca, ppm | >300 | >500 | N/A | add fertilizer to meet plant needs |
| Mg, ppm | >300 | >600 | N/A | add fertilizer to meet plant needs |
| Na | see SAB (ESP) | | | |
| S ⁶ , ppm | >200 | see EC | | add fertilizer to meet plant needs |
| Zn, ppm | >1.0 | >300 | >300 | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| Fe, ppm | >4 | >6 (and <1.2 for tolerant species) | Utility | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| Mn, ppm | >6 | >8 | >80 | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| Co, ppm | 0.2-2.0 | 0.4-2.0 | >20 | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| B, ppm | 0.8-2.0 | 1-2 | >2.4 | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| Cl, ppm | any | 12-175 | >175-700 | add fertilizer to meet plant needs. If value is low, if too high then reject soil |
| All | 1.0-10 | 0 | >10-20 | if high, raise soil pH to greater than 5.5 with lime (see pH) |

2.02 PLANT MATERIALS

A. Plants

A. Plants shall be typical of their species and variety, have normal growth habits, well developed branches, dense foliage, vigorous, fibrous root systems.

Plants shall be free from defects and injuries. All shipments of plant stock shall comply with existing State and Federal laws and regulations governing plant disease and infection and interstate movement of nursery stock.

Quality and size of plants, spread of roots, and size of balls shall be in accordance with USA-Z601-1973 "American Standard for Nursery Stock" as published by the American Association of Nurserymen. The caliper of trees shall be measured at 6 inches above the surface of the ground. Plant lists indicate minimum size requirements only. Plant materials shall be equal to or greater in size than those specified.

Plants shall not be pruned before planting.

All trees must have straight trunks with single leader intact, except in the case of specimen plants or otherwise indicated by the plan. Bark shall be free of abrasion, all cuts over 1-1/4" shall have callused over.

Trees shall not be accepted which have had their leaders cut or which have leaders damaged so that cutting is necessary.

Trees and shrubs shall be true to name.

Upon request, Contractor shall furnish the landscape architect a list indicating the source of each of the different plants to be supplied.

All Plants shall be ball and burlap or container grown unless otherwise indicated on the Plant Material List.

All plants shall be even in growth with balanced root and top growth and shall be No.1 in grade or type conforming to the latest edition of American Standard for Nursery Stock.

Plant material shall be nursery grown and shall have received the proper fertilizing, watering, root pruning and such other care as is normally given for a particular plant under nursery conditions. All plants shall be hardy under climate conditions similar to those in the locality of the project.

All material shall be freshly dug according to American Standard for Nursery Stock. All ball and burlap material shall be of firm earth from the original soil in which the plant grew. The ball shall be wrapped with burlap and tightly tied or enclosed in a tight fitting wire basket to hold it firm and intact. Any plants with broken or loose balls or manufactured balls will be rejected.

All plant material in containers shall have been established in that container. Any newly potted material will be rejected.

2.03 FERTILIZER FOR PLANT MATERIAL

A. Fertilize trees and shrubs with a fertilizer tablet having a slow release nitrogen, phosphorus and potash (20-10-5) plus sulphur and iron formulation. 21 gram tablets manufactured by Agforn or equal. Jobe Tree Spikes are acceptable.

Execution: Position plant in hole and backfill by $\frac{1}{2}$ the ball root height. Place tablet(s) beside the root ball about 1 inch from root tips. Do not place tablets in the bottom of the plant hole. Complete backfill, tamp and water.

- 1-2 Gallon Size: 1 Tablet
- 3-5 Gallon Size: 3 Tablets
- 15 Gallon Size: 7 Tablets
- 1.5" Caliper Trees: 6 Tablets
- 2" Caliper Trees: 6 Tablets
- 3" Caliper Trees: 12 Tablets

Any fertilizer that becomes caked or otherwise damaged, making it unsuitable for use will not be accepted.

2.04 ORGANIC/INORGANIC MULCH

Provide and place minimum three inch depth of stone mulch. Stone mulch shall be crushed gray 1" minus stone. Install 5 oz. DeWitt weed barrier fabric or equivalent under mulch with fabric staples installed at intervals that meet best practice and manufacturer requirements.

Submit samples of mulch to owner for approval prior to bulk delivery.

2.05 WEED CONTROL / PRE-EMERGENT

During construction, landscape contractor shall ensure all installed landscaped areas remain weed free. All spray applied weed control shall be applied by a certified chemical applicator and shall adhere to all local and state governing codes and manufacturer's recommended application rates and processes. Contractor shall be aware of high wind conditions and shall in no case apply weed control during a wind event that may carry product beyond its desired location.

Pre-Emergent weed killer shall be granulated and shall be "Treflan" or "Dacthal", or approved 12 month weed preventer. Product shall be delivered to the site in its original container, bearing the manufacturer's name and address. Pre-emergent shall be applied by landscape contractor following final soil grade and plant placement and prior to organic mulch placement. Care shall be taken to avoid spreading of Pre-Emergent on adjacent hardscapes and lawn areas. Ensure proper coverage as per manufacturer's recommendation.

2.06 LAWN

Contractor to recommend a drought tolerant bluegrass blend to landscape architect for approval prior to commencement of all work under this contract. Provide soil of uniform part sizes with maximum 5% deviation in either length or width. Broken pads or pads with uneven ends will not be acceptable. Sod pads incapable of supporting their own weight when suspended vertically with a firm grasp on